



**Technical and Test Institute
for Construction Prague**
Prosecká 811/76a
190 00 Prague
Czech Republic
eota@tzus.cz



Member of



www.eota.eu

European Technical Assessment

ETA 24/1141 of 22/11/2024

Technical Assessment Body issuing the ETA: Technical and Test Institute
for Construction Prague

Trade name of the construction product

MO-PSU

**Product family to which the
construction product belongs**

Product area code: 33
Injection anchors for use in masonry

Manufacturer

Index Técnicas Expansivas, S.L.
P.I. La Portalada II C/ Segador 13
26006 Logroño (La Rioja)
Spain
<https://www.indexfix.com/>

Manufacturing plant(s)

Index Plant 1

**This European Technical Assessment
contains**

13 pages including 10 Annexes which form
an integral part of this assessment.

**This European Technical Assessment is
issued in accordance with regulation
(EU) No 305/2011, on the basis of**

EAD 330076-01-0604
Metal injection anchors for use in masonry

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

1. Technical description of the product

The MO-PSU for masonry is a bonded anchor consisting of a cartridge with injection mortar, a plastic sieve sleeve and an anchor rod with a hexagon nut and a washer. The steel elements are made of galvanized steel or stainless steel.

The sieve sleeve is pushed into a drilled hole and filled with injection mortar before the anchor rod is placed in the sieve sleeve. The installation of the anchor rod in solid masonry is done without a sieve sleeve. The steel element is anchored via the bond between metal part, injection mortar and masonry.

The illustration and the description of the product are given in Annex A.

2. Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Reduction factor for job site tests (β – factor)	See Annex C 1
Characteristic resistance	See Annex C 1
Edge distances and spacing	See Annex B 5
Displacements	See Annex C 1
Durability	See Annex A 3

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorage satisfy requirements for Class A1

3.3 Hygiene, health and environment (BWR 3)

No performance determined.

3.4 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B 1 are kept.

4. Assessment and verification of constancy of performance (AVCP) system applied with reference to its legal base

According to the Decision 97/177/EC of the European Commission¹, the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table applies.

Product	Intended use	Level or class	System
Injection anchors for use in masonry	For fixing and/or supporting to masonry, structural elements (which contributes to the stability of the works) or heavy units	-	1

¹ Official Journal of the European Communities L 073 of 14.03.1997

5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD

The factory production control shall be in accordance with the control plan which is a part of the technical documentation of this European Technical Assessment. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited at Technický a zkušební ústav stavební Praha, s.p.² The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

Issued in Prague on 22.11.2024


By

Ing. Jiří Studnička, Ph.D.
Head of the Technical Assessment Body

² The control plan is a confidential part of the documentation of the European Technical Assessment, but not published together with the ETA and only handed over to the approved body involved in the procedure of AVCP.


Installation in solid brick masonry

Installation of anchor rod without sieve sleeve

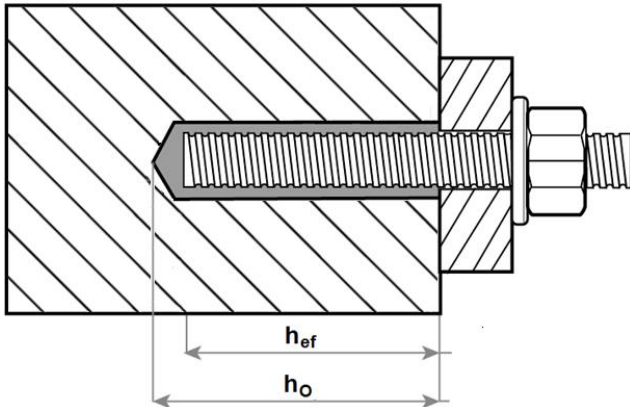

Installation in hollow or perforated brick masonry

Installation of anchor rod with sieve sleeve

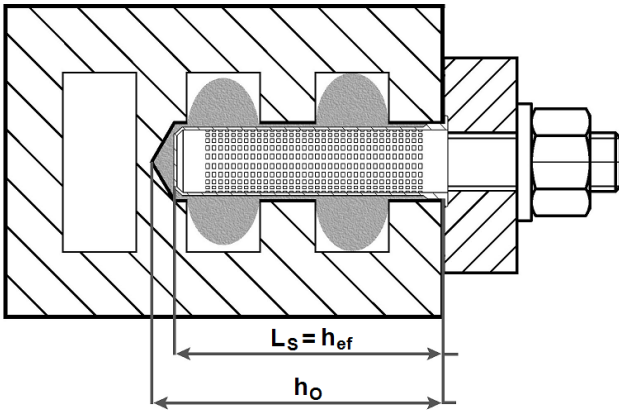

- L_s = length of the sieve sleeve
- h_{ef} = effective setting depth
- h_0 = bore hole depth

MO-PSU
for masonry

Product description
Installed condition

Annex A 1

Coaxial cartridge (CC)

MO-PSU


150 ml
380 ml
400 ml
410 ml



Side by side cartridge (SBS)

MO-PSU


350 ml
360 ml
825 ml

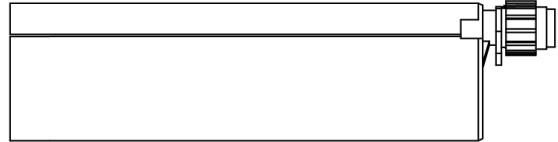

Two part foil in a single piston component cartridge (FCC)

MO-PSU

150 ml
170 ml
300 ml
550 ml
850 ml

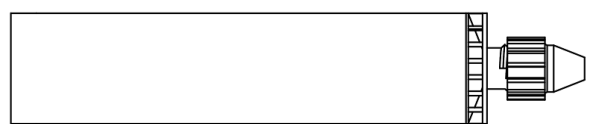


Marking of the mortar cartridges

Identifying mark of the producer, Trade name, Charge code number, Storage life, Curing and processing time

Mixing nozzle

KW



EZ-Flow




**MO-PSU
for masonry**

Product description
Injection system

Annex A 2

Threaded rod M6, M8, M10, M12

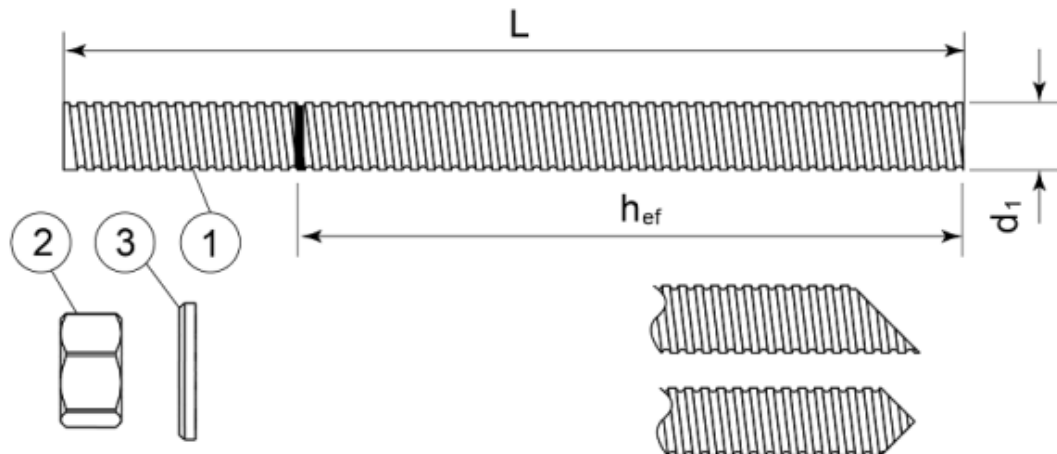

Standard commercial threaded rod with marked embedment depth

Part	Designation	Material
Steel, zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or Steel, Hot-dip galvanized $\geq 40 \mu\text{m}$ acc. to EN ISO 1461 and EN ISO 10684 or Steel, zinc diffusion coating $\geq 15 \mu\text{m}$ acc. to EN 13811		
1	Anchor rod	Steel, EN 10087 or EN 10263 Property class 5.8, 8.8, 10.9 ¹⁾ EN ISO 898-1
2	Hexagon nut EN ISO 4032	According to threaded rod, EN 20898-2
3	Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094	According to threaded rod
Stainless steel		
1	Anchor rod	Material: A2-70, A4-70, A4-80, EN ISO 3506
2	Hexagon nut EN ISO 4032	According to threaded rod
3	Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094	According to threaded rod
High corrosion resistant steel		
1	Anchor rod	Material: 1.4529, 1.4565, EN 10088-1
2	Hexagon nut EN ISO 4032	According to threaded rod
3	Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094	According to threaded rod


¹⁾ Galvanized rod of high strength are sensitive to hydrogen induced brittle failure

**MO-PSU
for masonry**

Product description
Threaded rod and materials

Annex A 3

Sieve sleeve

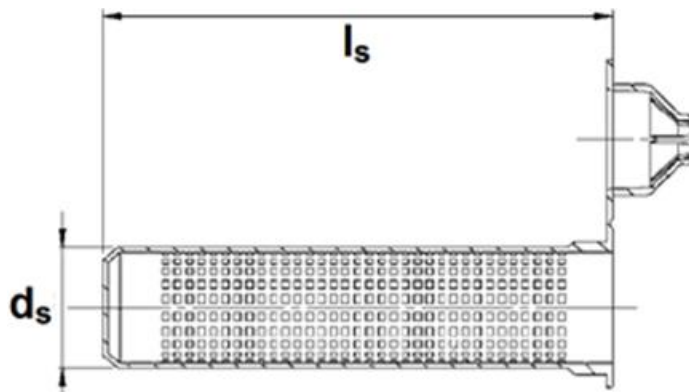

Types:
SH12/80
SH16/85

Designation	Material
Sieve sleeve	Polypropylene

**MO-PSU
for masonry**

Product description
Sleeve

Annex A 4

Specifications of intended use

Anchorage subject to:

- Static and quasi-static loads

Base materials

- Solid brick masonry (Use category b), according to Annex B2.
- Hollow brick masonry (Use category c), according to Annex B2.
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010.
- For other bricks in solid masonry, hollow or perforated masonry characteristic resistance of the anchorages may be determined by job site tests according to EOTA Technical Report TR 053 and under consideration of the β -factor to Annex C1, Table C4 or Annex C 2, Table C8.

Note: The characteristic resistances for solid bricks are also valid for larger brick sizes and larger compressive strength of the masonry unit.

Temperature range:

- T_a : -40°C to +40°C (max. short. term temperature +40°C and max. long term temperature +24°C)
- T_b : -40°C to +80°C (max. short. term temperature +80°C and max. long term temperature +50°C)

Use conditions (Environmental conditions)

- Structures subject to dry, internal conditions (all materials)
- For all other conditions according to EN 1993-1-4 corresponding to corrosion resistance class:
 - Stainless steel A2 according to Annex A 4, Table A1: CRC II
 - Stainless steel A4 according to Annex A 4, Table A1: CRC III
 - High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V

Use categories in respect of installation and use:

- Category d/d - Installation and use in structures subject to dry, internal conditions
- Category w/d - Installation in dry or wet substrate and use in structures subject to dry, internal conditions
- Category w/w - Installation and use in structures subject to dry or wet environmental conditions

Design:

- Verifiable calculation notes and drawings are prepared taking account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is indicated on the design drawings.
- The anchorages are designed in accordance with the EOTA Technical Report TR 054, Design method A under the responsibility of an engineer experienced in anchorages and masonry work.

Installation:

- Dry or wet structures
- Anchor Installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.


**MO-PSU
for masonry**

**Intended use
Specifications**

Annex B 1

Table B1: Types and dimensions of block and bricks

Brick N° 1

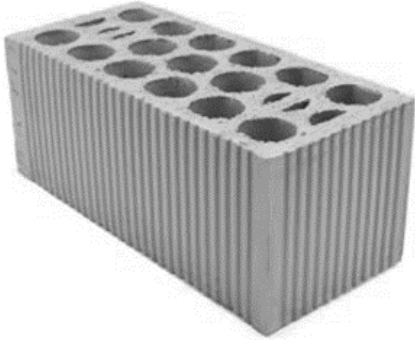


Perforated clay brick PERFORADO 10
according to EN 771-1
length/width/height = 245 mm/110 mm/100 mm
 $f_b \geq 15 \text{ N/mm}^2$ / $\rho \geq 2,05 \text{ kg/dm}^3$

Brick N° 2



Hollow clay brick Porotherm P+W
according to EN 771-1
length/width/height = 373 mm/250 mm/238 mm
 $f_b \geq 12 \text{ N/mm}^2$ / $\rho \geq 0,9 \text{ kg/dm}^3$

Brick N° 3




Solid clay brick Mz-NF
according to EN 771-1
length/width/height = 240 mm / 115 mm / 71 mm
 $f_b \geq 20 \text{ N/mm}^2$ / $\rho \geq 1,9 \text{ kg/dm}^3$

MO-PSU
for masonry

Intended use
Brick types and properties


Annex B 2

Applicator gun

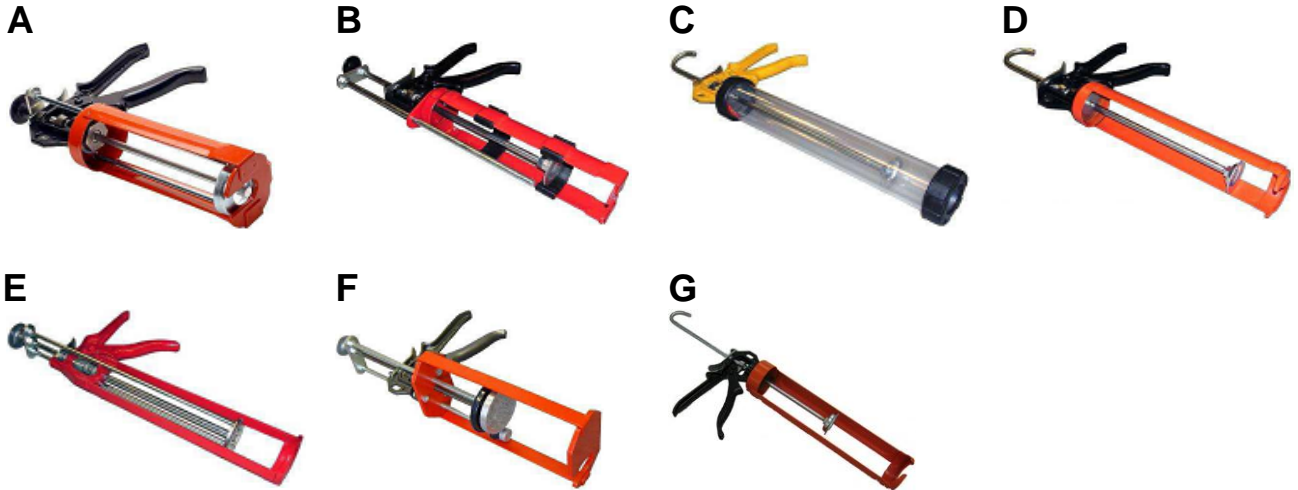


Applicator gun	A	B	C	D	E	F	G
Cartridge	Coaxial 380ml 400ml 410ml	Side by side 350ml 360ml	Foil capsule 150ml 300ml 550ml	Foil capsule 150ml 300ml	Coaxial 150ml	Side by side 825ml	Foil capsule 850ml

Cleaning brush

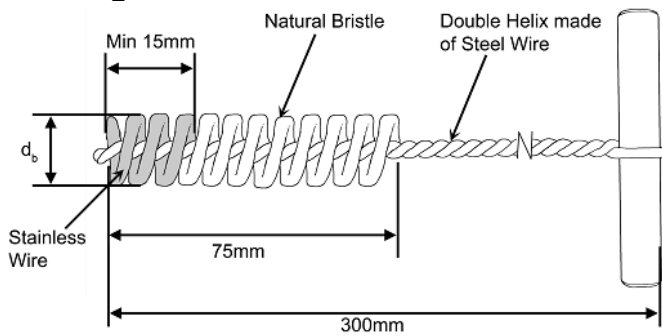

Cleaning pump

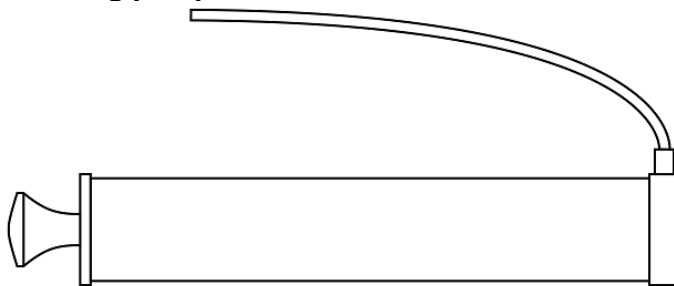

















**MO-PSU
for masonry**

Intended use
Applicator guns
Cleaning brush, Cleaning pump

Annex B 3

Installation instructions

	<p>1. Drill the hole to the correct diameter and depth using a rotary percussive machine.</p>		<p>2. Use the cleaning pump to clean the hole.</p>
	<p>3. Use the cleaning brush to clean the hole. Diameter of cleaning brush according to Table B2 or B4.</p>		<p>4. Use the cleaning pump to clean the hole.</p>
	<p>5. Use the cleaning brush to clean the hole. Diameter of cleaning brush according to Table B2 or B4.</p>		<p>6. Use the cleaning pump to clean the hole.</p>
	<p>7. If use in hollow or perforated brick masonry: Plug the centering cap and insert the correct perforated sleeve flush with the surface of the base material.</p>		<p>8. Once the hole is prepared remove the screw cap from the cartridge.</p>
	<p>9. Attach the mixer nozzle and place the cartridge in the applicator gun.</p>		<p>10. Dispense the first part to waste, until an even colour is achieved.</p>
	<p>11. Remove any free water from the hole.</p>		<p>12. Insert the nozzle to the far end of the hole (using extension tubing if necessary) and inject the resin, withdrawing the nozzle/tube as the hole fills.</p>
	<p>13. If use in hollow or perforated brick masonry: Insert mixer nozzle to the end of the perforated sleeve and completely fill the sleeve with resin. Withdraw the mixer nozzle as the sleeve fills.</p>		<p>14. Immediately insert the fixing (steel element) slowly and with a slight twisting motion. Remove excess resin from around the mouth of the hole.</p>
	<p>15. Leave the fixing undisturbed until the cure time (see Table B9) has elapsed.</p>		<p>16. Attach the fixture and tighten the nut. Maximum installation torque moment according to Table B3, B5 or B7.</p>

MO-PSU
for masonry

Intended use
Installation instructions

Annex B 4

Table B2: Installation parameters in hollow masonry with sleeve

Anchor type		Anchor rod with sleeve				
Size		M6	M8	M8	M10	M12
Sieve sleeve	l_s [mm]	80	80	85	85	85
	d_s [mm]	12	12	16	16	16
Nominal drill hole diameter		d_o [mm]	12	12	16	16
Diameter of cleaning brush		d_b [mm]	14 ^{±1}	14 ^{±1}	20 ^{±1}	20 ^{±1}
Depth of the drill hole		h_o [mm]	85		90	
Effective anchorage depth		h_{ef} [mm]	80		85	
Diameter of clearance hole in the fixture		$d_f \leq$ [mm]	7	9	9	12
Torque moment		$T_{inst} \leq$ [Nm]	2			

Table B3: Edge distances and spacing in solid or hollow masonry with sleeve

Anchor rod						
Base material ¹⁾	M6, M8 with sleeve SH12/80			M8, M10, M12 with sleeve SH16/85		
	$C_{cr} \parallel C_{min}$	$S_{cr \parallel} \parallel S_{min \parallel}$	$S_{cr \perp} \parallel S_{min \perp}$	C_{cr}	$S_{cr \parallel} \parallel S_{min \parallel}$	$S_{cr \perp} \parallel S_{min \perp}$
	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
Brick N° 1	100	245	110	-	-	-
Brick N° 2	-	-	-	100	373	238

¹⁾ Brick N° according to Annex B 2

Table B4: Installation parameters in solid masonry without sleeve

Anchor type		Anchor rod without sleeve				
Size		M6	M8	M10	M12	
Nominal drill hole diameter		d_o [mm]	8	10	12	
Diameter of cleaning brush		d_b [mm]	9 ^{±1}	14 ^{±1}	14 ^{±1}	
Depth of the drill hole		h_o [mm]	80	90		
Effective anchorage depth		h_{ef} [mm]	80	90		
Diameter of clearance hole in the fixture		$d_f \leq$ [mm]	7	9	12	
Torque moment		$T_{inst} \leq$ [Nm]	2			

Table B5: Edge distances and spacing in solid masonry without sleeve

Anchor rod						
Base material ¹⁾	M6			M8, M10, M12		
	$C_{cr} \parallel C_{min}$	$S_{cr \parallel} \parallel S_{min \parallel}$	$S_{cr \perp} \parallel S_{min \perp}$	C_{cr}	$S_{cr \parallel} \parallel S_{min \parallel}$	$S_{cr \perp} \parallel S_{min \perp}$
	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
Brick N° 3	120	240	240	135	270	270

¹⁾ Brick N° according to Annex B 2

Table B6: Minimum curing time

Resin cartridge temperature	T Work	Base material Temperature	T Load
min +5°C	18 Minutes	min +5°C	160 Minutes
+5°C to +10°C	10 Minutes	+5°C to +10°C	
+10°C to +20°C	6 Minutes	+10°C to +20°C	90 Minutes
+20°C to +25°C	5 Minutes	+20°C to +25°C	60 Minutes
+25°C to +30°C	4 Minutes	+25°C to +30°C	50 Minutes
+30°C		+30°C	40 Minutes

T Work is typical gel time at highest base material temperature in the range.

T Load is minimum set time required until load can be applied at the lowest temperature in the range.

**MO-PSU
for masonry**

Intended use
Installation parameters
Working and curing time

Annex B 5

Table C1: Characteristic resistance under tension and shear loading

Base material	Anchor rods with sleeve $N_{Rk} = V_{Rk}$ [kN] ¹⁾										Anchor rods without sleeve $N_{Rk} = V_{Rk}$ [kN] ¹⁾							
	Use conditions d/d					Use conditions w/d; w/w					Use conditions d/d				Use conditions w/w; w/d			
	M6	M8	M8	M10	M12	M6	M8	M8	M10	M12	M6	M8	M10	M12	M6	M8	M10	M12
Temperature range T_a: -40°C to +40°C																		
Sleeve	12/80		16/85			12/80		16/85										
Brick N° 1	1,5	1,5	-			1,5	1,5	-			-				-			
Brick N° 2	-		1,2	1,5	1,5	-		0,9	1,2	1,2								
Brick N° 3	-					-					1,5	1,5	2,0	2,5	0,9	1,2	2,0	2,0
Temperature range T_b: -40°C to +80°C																		
Sleeve	12/80		16/85			12/80		16/85										
Brick N° 1	1,2	1,2	-			1,2	1,2	-			-				-			
Brick N° 2	-		0,9	1,2	1,2	-		0,9	1,2	1,2								
Brick N° 3	-					-					1,2	1,2	1,5	2,0	0,9	0,9	1,5	1,5

¹⁾ For design according TR 054: $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{Rk,s}$; $N_{Rk,pb}$ according to TR 054
For $V_{Rk,s}$ see Annex C1, Table C2; Calculation of $V_{Rk,pb}$ and $V_{Rk,c}$ according to TR 054

Table C2: Characteristic resistance under shear loading – steel failure

Size		M6	M8	M10	M12	Partial safety factor γ_{Ms}
Characteristic shear resistance						
Steel grade 5.8	$V_{Rk,s}$ [kN]	5	9	15	21	1,25
Steel grade 8.8	$V_{Rk,s}$ [kN]	8	15	23	34	1,25
Steel grade 10.9	$V_{Rk,s}$ [kN]	10	18	29	42	1,50
Stainless steel grade A2-70, A4-70	$V_{Rk,s}$ [kN]	7	13	20	30	1,56
Stainless steel grade A4-80	$V_{Rk,s}$ [kN]	8	15	23	34	1,33
Stainless steel grade 1.4529 strength class 70	$V_{Rk,s}$ [kN]	7	13	20	30	1,25
Stainless steel grade 1.4565 strength class 70	$V_{Rk,s}$ [kN]	7	13	20	30	1,56
Characteristic bending moment						
Steel grade 5.8	$M_{Rk,s}$ [N.m]	8	19	37	66	1,25
Steel grade 8.8	$M_{Rk,s}$ [N.m]	12	30	60	105	1,25
Steel grade 10.9	$M_{Rk,s}$ [N.m]	15	37	75	131	1,50
Stainless steel grade A2-70, A4-70	$M_{Rk,s}$ [N.m]	11	26	52	92	1,56
Stainless steel grade A4-80	$M_{Rk,s}$ [N.m]	12	30	60	105	1,33
Stainless steel grade 1.4529 strength class 70	$M_{Rk,s}$ [N.m]	11	26	52	92	1,25
Stainless steel grade 1.4565 strength class 70	$M_{Rk,s}$ [N.m]	11	26	52	92	1,56

Table C3: Displacements under tension and shear load

Base material	F [kN]	δ_{N0} [mm]	$\delta_{N\infty}$ [mm]	δ_{V0} [mm]	$\delta_{V\infty}$ [mm]
Brick N° 1	$N_{Rk} / (1,4 \cdot \gamma_M)$	0,5	1,0	1,0 ¹⁾	1,5 ¹⁾
Brick N° 2	$N_{Rk} / (1,4 \cdot \gamma_M)$	0,4	0,8	0,6 ¹⁾	0,9 ¹⁾
Brick N° 3	$N_{Rk} / (1,4 \cdot \gamma_M)$	0,2	0,3	0,7 ¹⁾	1,1 ¹⁾

¹⁾ the hole gap between bolt and fixture shall be considered additionally

Table C4: β - factors for job site tests according to TR 053

Brick N°	N° 1	N° 2	N° 3
β - factor – Use conditions d/d	0,71	0,71	0,51
β - factor – Use conditions w/d; w/w	0,71	0,64	0,37

**MO-PSU
for masonry**

Performances

Characteristic resistance, displacement
 β -factors for job site testing under tension load

Annex C 1