



**INSTITUTO DE CIENCIAS  
DE LA CONSTRUCCIÓN  
EDUARDO TORROJA**

C/ Serrano Galvache n. 4 28033 Madrid (Spain)  
Tel.: (34) 91 302 04 40 Fax: (34) 91 302 07 00  
[direccion.ietcc@csic.es](mailto:direccion.ietcc@csic.es) [www.ietcc.csic.es](http://www.ietcc.csic.es)

**European Technical  
Assessment**

**ETA 24/0011  
of 09/01/2024**

English translation prepared by IETcc. Original version in Spanish language

**General Part**

**Technical Assessment Body issuing the ETA designated according to Art. 29 of Regulation (EU) 305/2011:**

Instituto de Ciencias de la Construcción Eduardo Torroja (IETcc)

**Trade name of the construction product**

**NA nail anchor**

**Product family to which the construction product belongs**

Anchor made of galvanized steel for use in concrete for redundant non-structural systems.

**Manufacturer**

**Index – Técnicas Expansivas S.L.**  
Segador 13  
26006 Logroño (La Rioja)  
Spain.  
Webpage: [www.indexfix.com](http://www.indexfix.com)

**Manufacturing plants**

Index plant 2

**This European Technical Assessment contains**

9 pages including 3 annexes which form an integral part of this assessment.

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

European Assessment Document 330747-00-0601 “Fasteners for use in concrete in redundant non-structural systems”, edition May 2018



*English translation prepared by IETcc*

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission according to article 25 (3) of Regulation (EU) No 305/2011.

Código seguro de Verificación : GEN-fbdd-2788-054b-05c0-792c-c7a3-f77b-1dd2 | Puede verificar la integridad de este documento en la siguiente dirección : <https://portafirmas.redsara.es/pf/valida>

---

CSV : GEN-fbdd-2788-054b-05c0-792c-c7a3-f77b-1dd2

DIRECCIÓN DE VALIDACIÓN : <https://portafirmas.redsara.es/pf/valida>

FIRMANTE(1) : ANGEL CASTILLO TALAVERA | FECHA : 01/03/2024 19:02 | Sin acción específica



## SPECIFIC PART

### 1. Technical description of the product

The Index NA nail anchor in diameter 6 is an anchor made of galvanized steel. The anchor is installed into a predrilled cylindrical hole and anchored by deformation-controlled expansion.

Product and product description is given in annex A.

### 2. Specification of the intended use in accordance with the applicable European Assessment Document.

The performances given in section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a mean to choosing the right products in relation to the expected economically reasonable working life of the works.

### 3. Performance of the product and references to the methods used for its assessment

#### 3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorage satisfy requirements for class A1 according to EN 13501-1
Essential characteristics under fire exposure	See annex C3

#### 3.2 Safety in use (BWR 4)

Essential characteristic	Performance
Essential characteristics in concrete	See annex C3

### 4. Assessment and Verification of Constancy of Performances (hereinafter AVCP) system applied, with reference to its legal base

The applicable European legal act for the system of Assessment and Verification of Constancy of Performances (see annex V to Regulation (EU) No 305/2011) is 97/161/EC.

The system to be applied is 2+.

### 5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document.

The technical details necessary for the implementation of the AVCP system are laid down in the quality plan deposited at Instituto de ciencias de la construcción Eduardo Torroja.





Instituto de ciencias de la construcción Eduardo Torroja  
CONSEJO SUPERIOR DE INVESTIGACIONES CIENTÍFICAS

C/ Serrano Galvache n.º 4. 28033 Madrid.  
Tel: (+34) 91 302 04 40 Fax. (+34) 91 302 07 00  
www.ietcc.csic.es




On behalf of the Instituto de Ciencias de la Construcción Eduardo Torroja  
Madrid, 9<sup>th</sup> of January 2024

Mr. Ángel Castillo Talavera  
Director



**Product versions**

NA Nail anchor

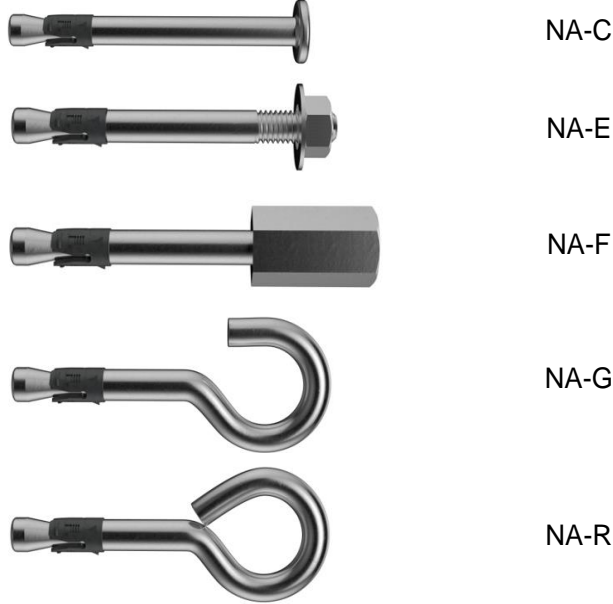

Marking: clip: "NA" + "Ø6" + company logo

**Table A1: Materials**

Item	Designation	Material for NA
1	Anchor body	Carbon steel, galvanized $\geq 5 \mu\text{m}$ ISO 4042 Zn5
2	Clip	Carbon steel, sherardized $\geq 40 \mu\text{m}$ EN 13811
3	Washer	Galvanized $\geq 5 \mu\text{m}$ ISO 4042 Zn5
4	Nut	DIN 934 class 6, galvanized $\geq 5 \mu\text{m}$ ISO 4042 Zn5
5	Coupling nut	Galvanized $\geq 5 \mu\text{m}$ ISO 4042 Zn5

NA Nail anchor

Product description

Product versions and materials

Annex A1



### **Specifications of intended use**

#### **Anchorage subjected to:**

- Static or quasi static loads in redundant non-structural systems.
- Use for anchorages with requirements related to resistance of fire.
- The anchor may only be used if in the design and installation specifications for the fixture the excessive slip or failure of one anchor will not result in a significant violation of the requirements on the fixture in the serviceability and ultimate state.

#### **Base materials:**

- Reinforced or unreinforced normal weight concrete without fibres according to EN 206-1:2013+A2:2021.
- Strength classes C20/25 to C50/60 according to EN 206-1:2013+A2:2021.
- Cracked or uncracked concrete

#### **Use conditions (environmental conditions):**

- Temperature range of the anchorage base material during the working life: -40 °C to +80 °C.
- Anchorages subjected to dry internal conditions.

#### **Design:**

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete.
- Verifiable calculation rules and drawings are prepared taking into account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed for design method B in accordance with EN 1992-4:2018
- Anchorages under fire exposure are designed in accordance to EN 1992-4:2018. It must be ensured that local spalling of the concrete cover does not occur.

#### **Installation:**

- Hole drilling by rotary plus hammer mode.
- Anchor installation carried out by appropriately qualified personal and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- Anchor installation such the embedment depth is met.


<b>NA Nail anchor</b>	<b>Annex B1</b>
<b>Intended use</b>	
Specifications	



**Table C1: Installation parameters**

Installation parameters			Performances									
			NA-C		NA-E		NA-F		NA-R		NA-G	
$d_0$	Drill bit nominal diameter	[mm]	6		6		6		6		6	
$d_t$	Thread diameter	[mm]	---		M6		M8/M10		---		---	
$d_f$	Fixture clearance hole diameter $\leq$	[mm]	7		7		7		---		---	
$T_{ins}$	Maximum installation torque	[Nm]	---		7		---		---		---	
$h_1$	Depth of drilled hole	[mm]	35	40	35	40	35	40	35	40	35	40
$h_{nom}$	Overall anchor embedment depth	[mm]	30	35	30	35	30	35	30	35	30	35
$h_{ef}$	Effective anchorage depth	[mm]	25	30	25	30	25	30	25	30	25	30
$h_{min}$	Minimum thickness of concrete member	[mm]	80		80		80		80		80	
$t_{fix}$	Fixture thickness <sup>1)</sup> $\leq$	[mm]	L-30	L-35	L-39	L-44	--		--		--	
$c_{cr}$	Critical edge distance	[mm]	50	65	50	65	50	65	50	65	50	65
$s_{min}$	Minimum allowable spacing for $c \geq$	[mm]	35		35		35		35		35	
		[mm]	50		50		50		50		50	
$c_{min}$	Minimum allowable edge distance for $s \geq$	[mm]	35		35		35		35		35	
		[mm]	80		80		80		80		80	

<sup>1)</sup> L = anchor length

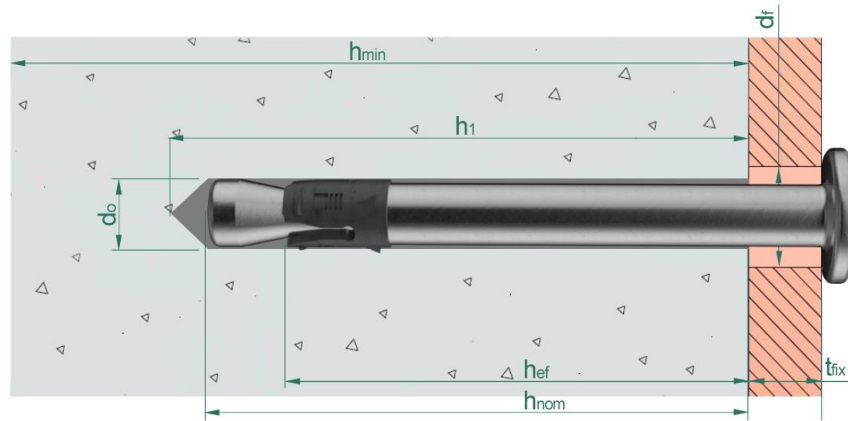

- $d_0$ : Drill bit nominal diameter
- $d_f$ : fixture clearance hole diameter
- $h_{ef}$ : effective anchorage depth
- $h_1$ : depth of drilled hole
- $h_{min}$ : minimum thickness of concrete member
- $h_{nom}$ : overall anchor embedment depth
- $t_{fix}$ : fixture thickness

**NA Nail anchor**

**Performances**































Installation parameters

**Annex C1**



English translation prepared by IETcc

Código seguro de Verificación : GEN-fbdd-2788-054b-05c0-792c-c7a3-f77b-1dd2 | Puede verificar la integridad de este documento en la siguiente dirección : <https://portafirmas.redsara.es/pf/valida>

<b>Installation procedure</b>						
NA-C						
NA-E						
NA-F						
NA-R						
NA-G						
<b>NA Nail anchor</b>					<b>Annex C2</b>	
<b>Performances</b>						
Installation procedure						





**Table C2: Essential characteristics in concrete of design method B according to EN 1992-4**

Characteristic resistance in concrete C20/25 to C50/60 to loads in any direction			Performances									
			NA-C		NA-E		NA-F		NA-R		NA-G	
$h_{nom}$	Embedment depth	[mm]	30	35	30	35	30	35	30	35	30	35
$h_{ef}$	Effective depth	[mm]	25	30	25	30	25	30	25	30	25	30
$F_{Rk}^0$	Characteristic resistance in concrete C20/25 to C50/60	[kN]	3,0	5,0	3,0	5,0	3,0	5,0	1,5	1,5	1,5	1,5
$\gamma_{ins}$	Installation factor	[-]	1,2	1,0	1,2	1,0	1,2	1,0	1,2	1,0	1,2	1,0
<b>Shear loads: steel failure with lever arm</b>												
$M_{Rk,s}^0$	Characteristic bending moment	[Nm]	12,1		12,1		12,10		NA		NA	
$\gamma_{Ms}$	Partial safety factor	[-]	1,25		1,25		1,25		NA		NA	

**Table C3: Essential characteristics under fire exposure in concrete according to EN 1992-4**

Characteristic resistance under fire exposure in concrete C20/25 to C50/60 to loads in any direction			Performances				
			NA-C	NA-E	NA-F	NA-R	NA-G
$F_{Rk,fi30}^0$	Characteristic resistance, 30 minutes	[kN]	0,27	0,27	0,27	0,27	0,27
$F_{Rk,fi60}^0$	Characteristic resistance, 60 minutes	[kN]	0,24	0,24	0,24	0,24	0,24
$F_{Rk,fi90}^0$	Characteristic resistance, 90 minutes	[kN]	0,19	0,19	0,19	0,19	0,19
$F_{Rk,fi120}^0$	Characteristic resistance, 120 minutes	[kN]	0,14	0,14	0,14	0,14	0,14
$M_{Rk,s,fi30}^0$	Characteristic bending moment, 30 minutes	[Nm]	0,20	0,20	0,20	NA	NA
$M_{Rk,s,fi60}^0$	Characteristic bending moment, 60 minutes	[Nm]	0,18	0,18	0,18	NA	NA
$M_{Rk,s,fi90}^0$	Characteristic bending moment, 90 minutes	[Nm]	0,14	0,14	0,14	NA	NA
$M_{Rk,s,fi120}^0$	Characteristic bending moment, 120 minutes	[Nm]	0,10	0,10	0,10	NA	NA

- 1) in absence of other national regulations the partial safety factor for resistance under fire exposure  $\gamma_{M,fi}=1.0$  is recommended.
- 2) If fire attack is from more than one side, the design method may be taken if edge distance of the anchor is  $c \geq 300$  mm

2

**NA Nail anchor**

**Performances**

Essential characteristics in concrete  
Essential characteristics under fire exposure

**Annex C3**

